




Primary Underground Pad Mount Transformer Underground Service

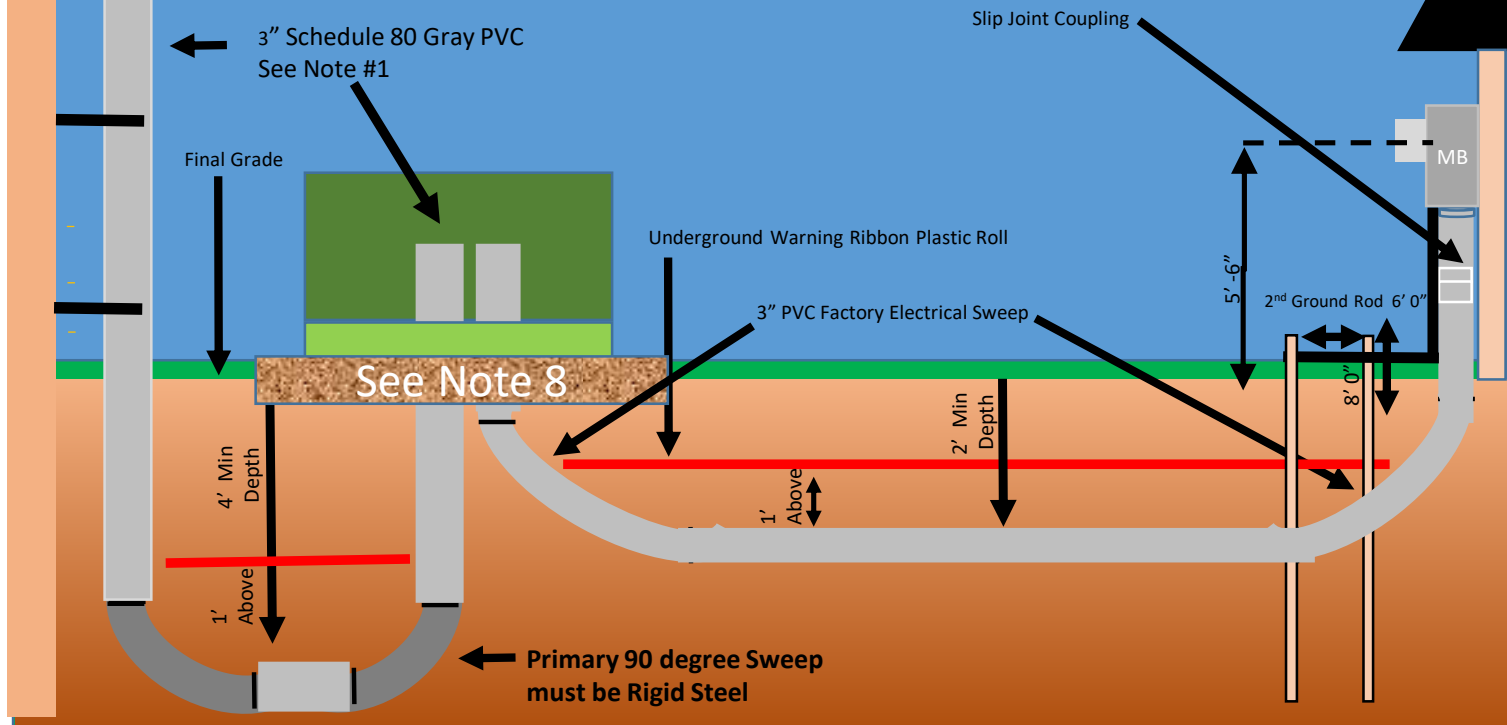

1. Single Phase 3", Multi-Phase 4" or as required by Operations Superintendent.
2. Any Plastic Piping coming out of ground must be Schedule 80. All In ground piping is Schedule 40.
3. Primary Electrical Sweeps must be Rigid Steel.
4. Plastic Pad Mount must set on a 6" gravel base.
5. Distance between pole and conduit should be 6" and BCES will provide stand off brackets.
6. Customer needs to have 3 sticks of Schedule 80 conduit at the pole as required by Operations Superintendent.
7. Customer will provide weather-head and BCES will install.
8. Gravel Base shall extend 1ft past pad on each side (Pad is 44" x 44")
9. Customer may elect to pour their pad per the specifications provided by the Operations Superintendent.